


PSV DATA

MFG: FARRIS
 MODEL: 26GA12-120/57
 SERIAL: CE-41879A10
 SET PRES: 4964 kPa
 CAPACITY: 7081 scfm
 SERVICED BY: UNIFIED VALVE
 SERVICE DATE: 07/2004
 SIZE: 1.5"x2.5"
 CODE STAMP: UV
 BLOCK VALVE: NO
 CRN: OG2369.5C
 LOCATION: DISCHARGE PIPING
 TAG: 1225F

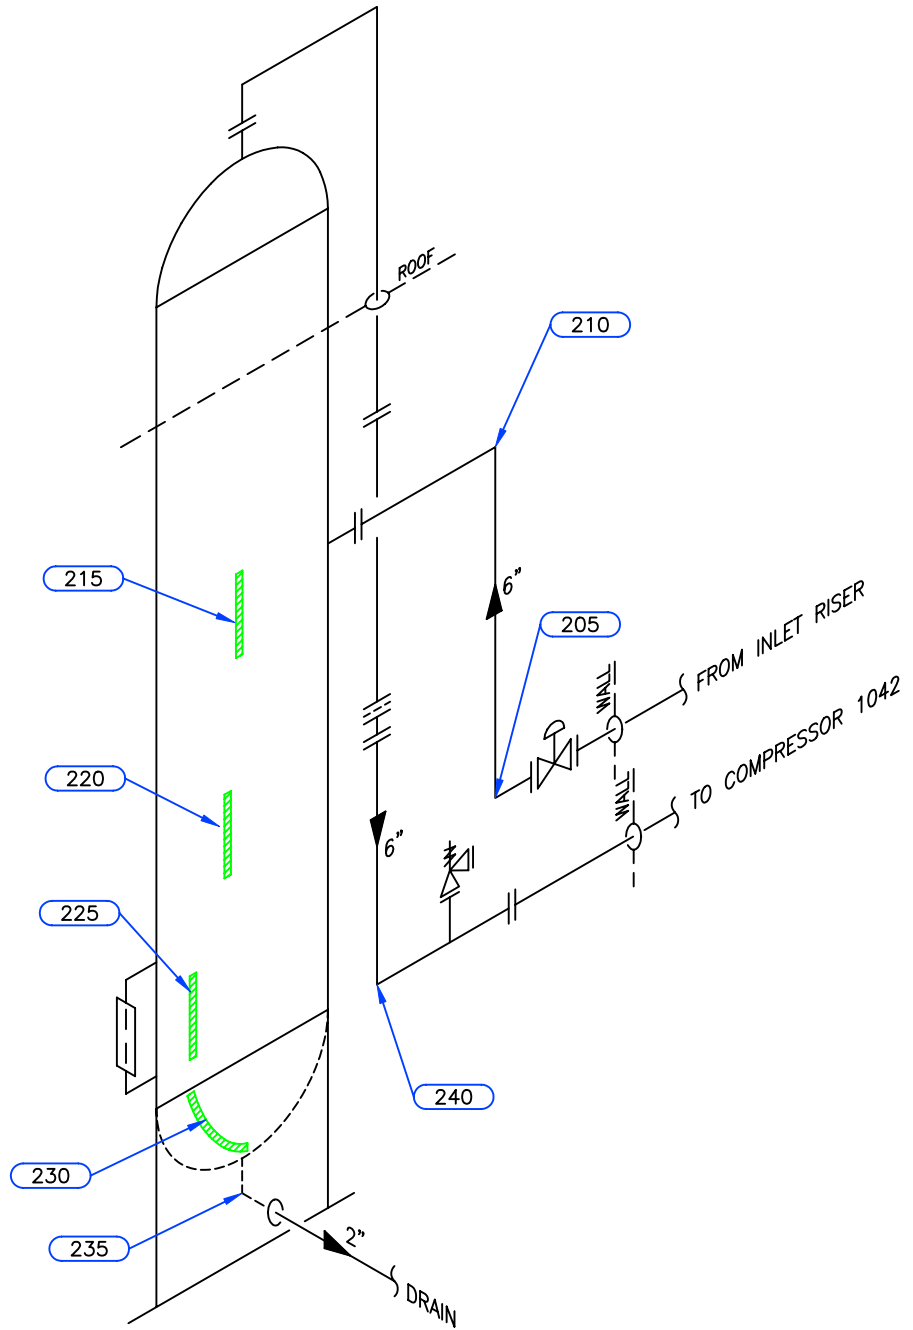

Equip. No. _____ Prov. Reg. No. Ⓐ 3098523 C.R.N. M-2318.213 Serial No. 95-7975-0 Yr. Inst. _____
 Code/Div. ASME VIII, Div 1 Size: 36in. x 10ft. Manufacturer: WELLS HALL FAB. Yr. Blt. 1995
 C. Stamp: U Service: SOUR PWHT: YES Radiography: RT-1 Insulated: NO

Design & Materials Data

HEAD:
 Top Mat'l. SA 516 70MT Top Nom. 27.8mm Top C.A. 3.2mm
 Btm. Mat'l. _____ Btm. Nom. _____ Btm. C.A. _____

CHANNEL:
 Material: _____ Nominal: _____ C.A. _____

BOOT
 Head Mat'l. _____ Head Nom. _____ Head C.A. _____
 Shell Mat'l. _____ Shell Nom. _____ Shell C.A. _____

SHELL
 Material: SA 516 70MT Nominal: 22.2mm C.A. 3.2mm
 MAWP Shell Side: 4964 kPa @ Temp. 38°C
 MAWP Tube Side: _____ @ Temp. _____

CLIENT	CANADIAN NATURAL RESOURCES LTD		
FACILITY	SOUTH BULRUSH COMPRESSOR STATION LSD b-88-F/94-A-16		
ITEM	INLET SEPARATOR		
BY: CB	DATE: 05/2004	DWG.# 2	